



Luminaire Schedule							
Symbol	Qty	Label	Description	Lum. Lumens	Lum. Watts	LLF	Filename
③	48	R-LAB-2173-1-V1 - A93 - Module Egress path 602mA-corr	E-LAB-2173-1	873	8.62	1.000	R-LAB-2173-1-V1 - A93 - Module Egress path 602mA- corr IEG


20ft mounting

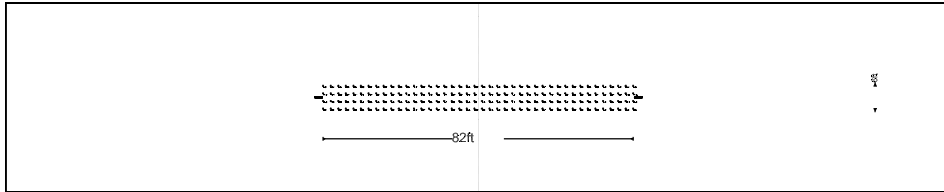


50ft mounting

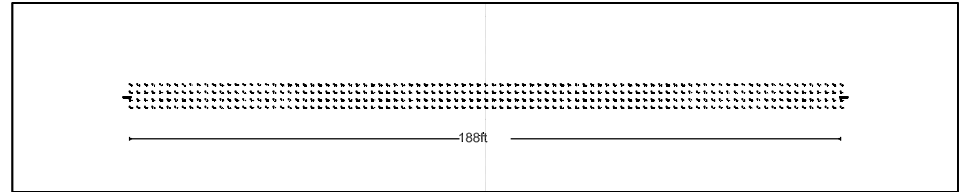


30ft mounting

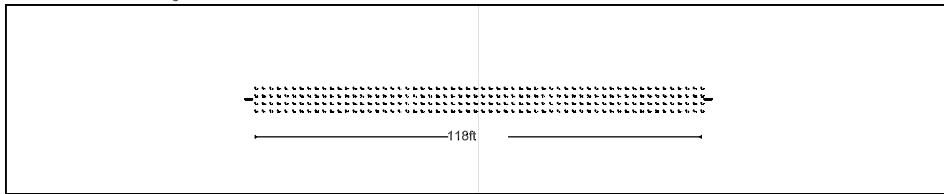


60ft mounting

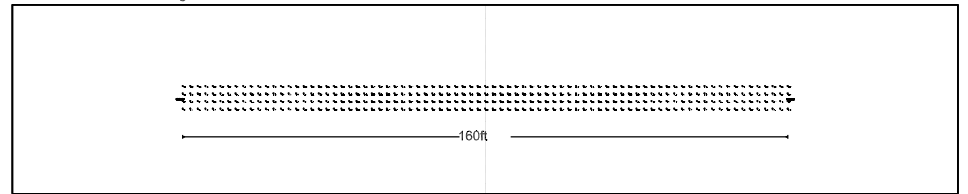

40ft mounting

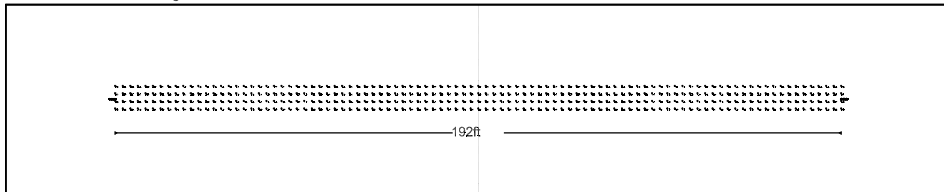

70ft mounting

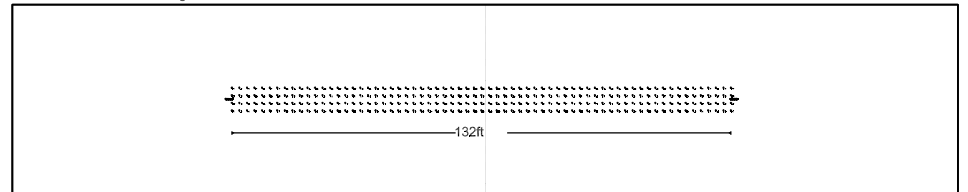

Calculation Summary								
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	Grid Z
20ft	Illuminance	Fc	4.01	11.5	0.3	13.37	38.33	0
30ft	Illuminance	Fc	2.25	6.7	0.2	11.25	28.50	0
40ft	Illuminance	Fc	1.18	3.7	0.1	11.80	37.00	0
50ft	Illuminance	Fc	1.01	2.4	0.1	10.10	24.00	0
60ft	Illuminance	Fc	1.01	1.7	0.7	1.44	2.43	0
70ft	Illuminance	Fc	1.06	1.3	0.9	1.18	1.44	0

Ceiling 70'
Level on the floor
Reflectances: 40-50-20