



Luminaire Schedule							
Symbol	Qty	Label	Description	Lum. Lumens	Lum. Watts	LLF	Filename
⑤	24	R-LAB-2173-1-V1 - ABS - Module Egress path 602mA.corr	E-LAB-2173-1	873	6.62	1.000	R-LAB-2173-1-V1 - ABS - Module Egress path 602mA- corr IEG


20ft mounting

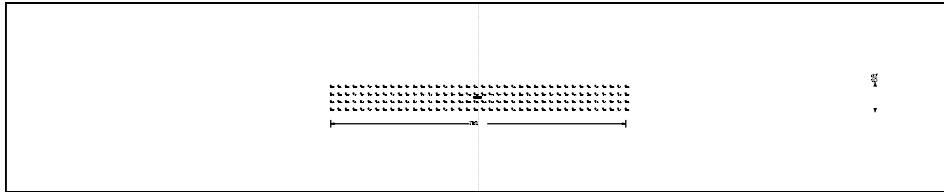


50ft mounting

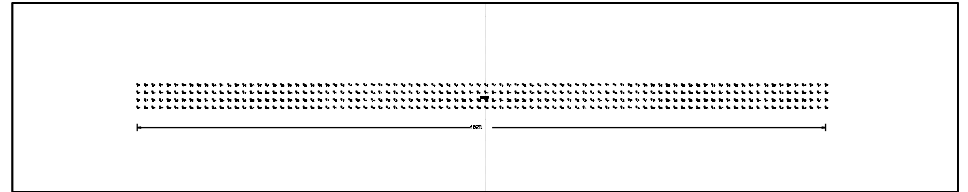


30ft mounting

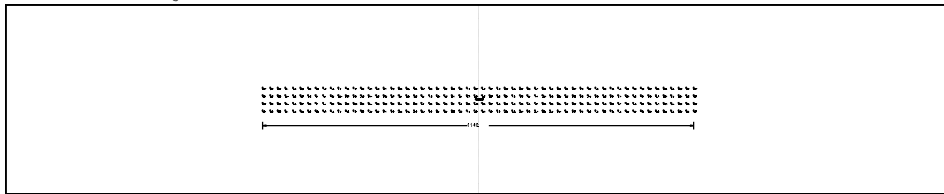


60ft mounting

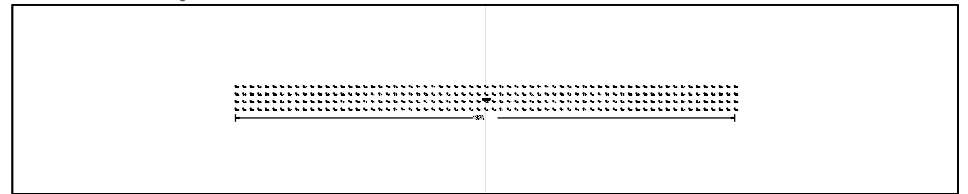

40ft mounting

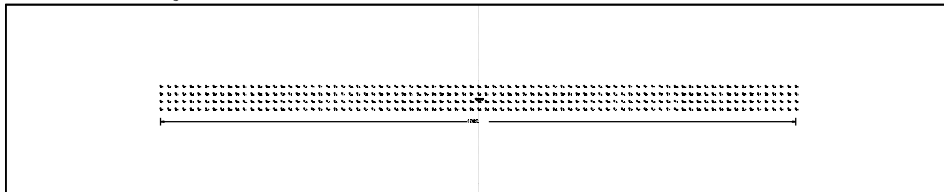

70ft mounting

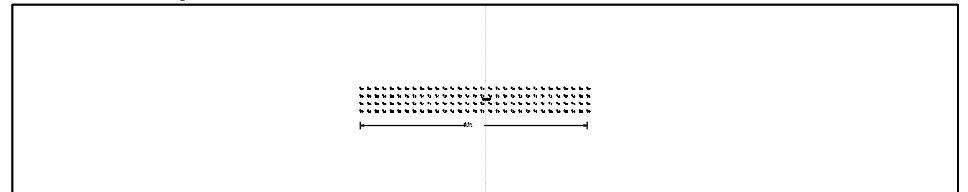

Calculation Summary								
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	Grid Z
20R	Illuminance	Fc	4.22	11.5	0.3	14.07	38.33	0
30R	Illuminance	Fc	2.35	6.7	0.2	11.75	28.50	0
40R	Illuminance	Fc	1.31	3.6	0.1	13.10	35.00	0
50R	Illuminance	Fc	1.00	2.4	0.1	10.00	24.00	0
60R	Illuminance	Fc	1.00	1.7	0.6	1.67	2.83	0
70R	Illuminance	Fc	1.00	1.2	0.8	1.25	1.50	0

Ceiling 70'
Level on the floor
Reflectances: 40-50-20